
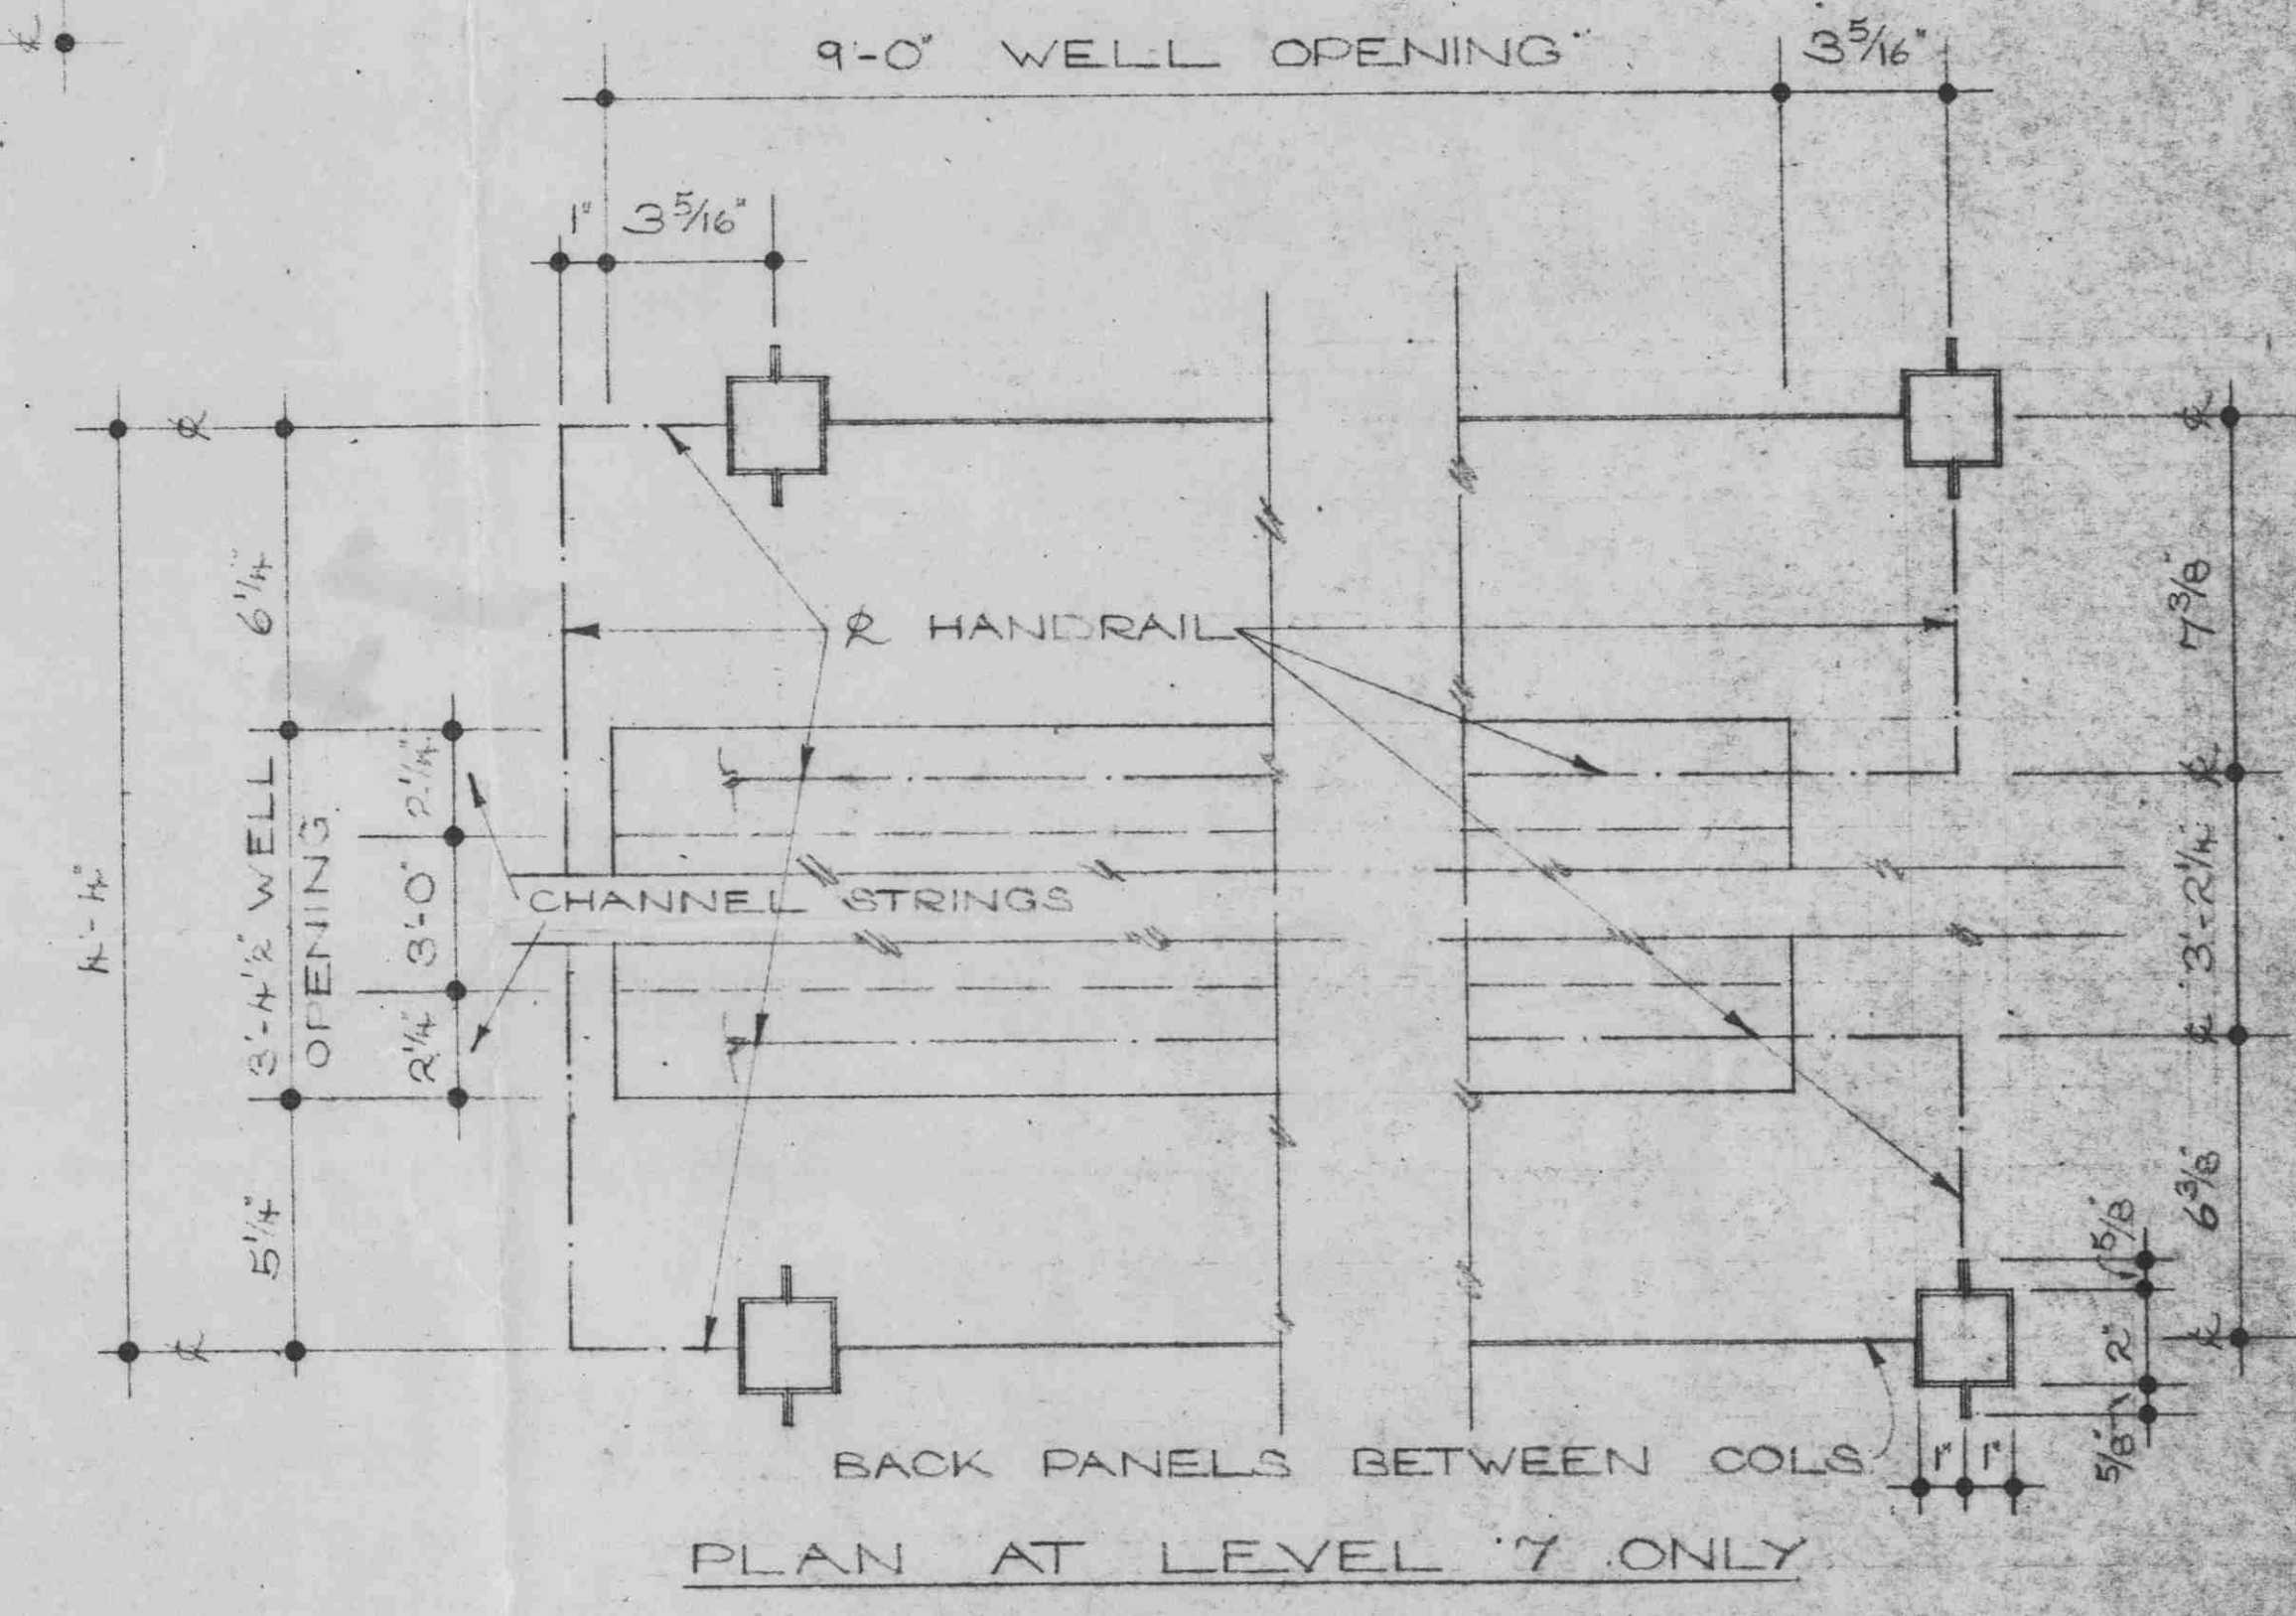
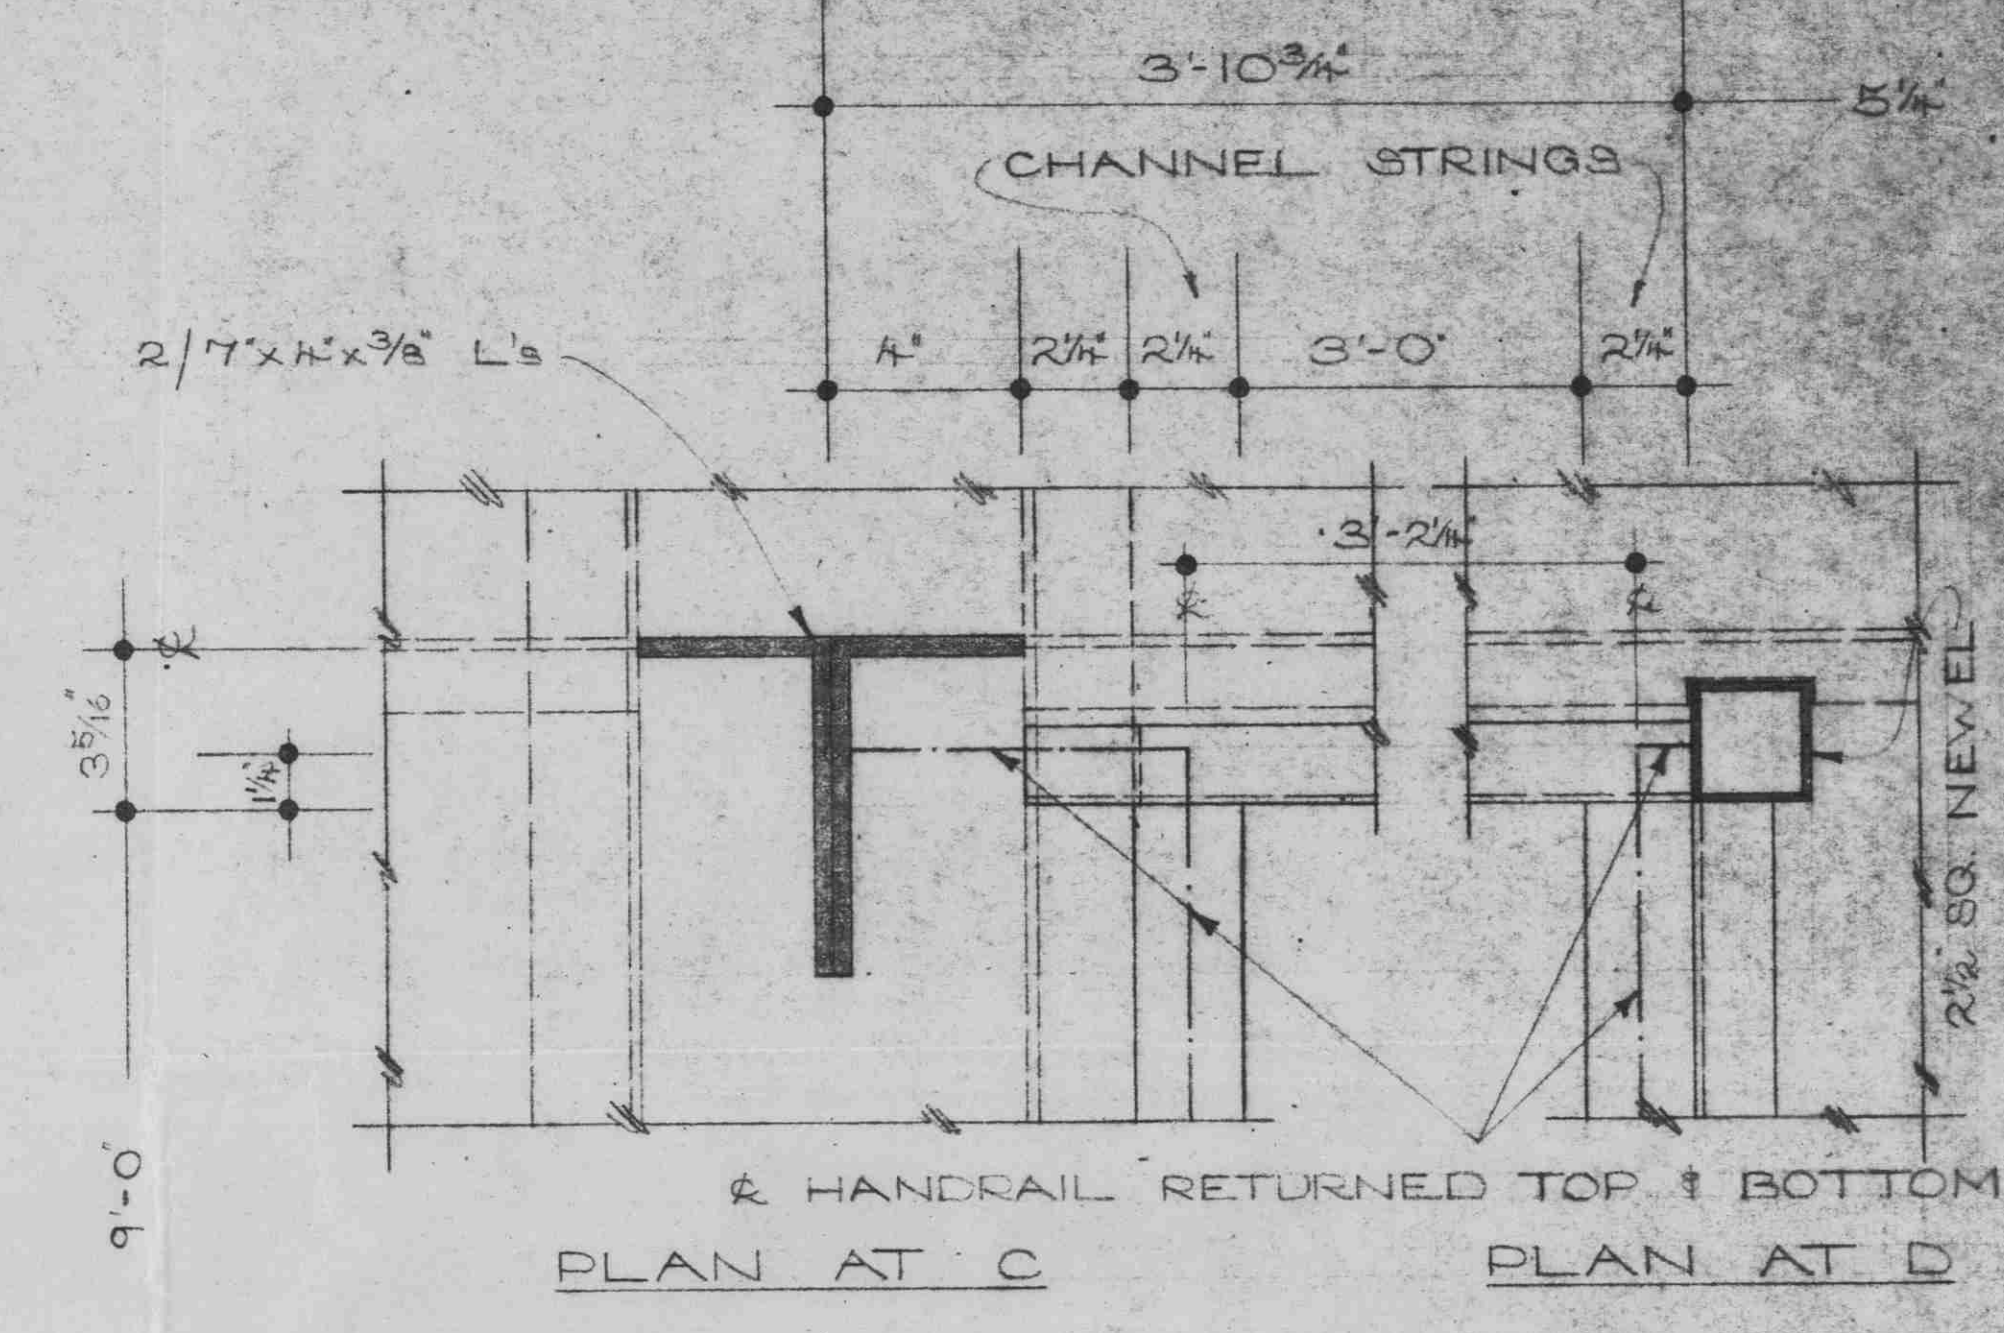
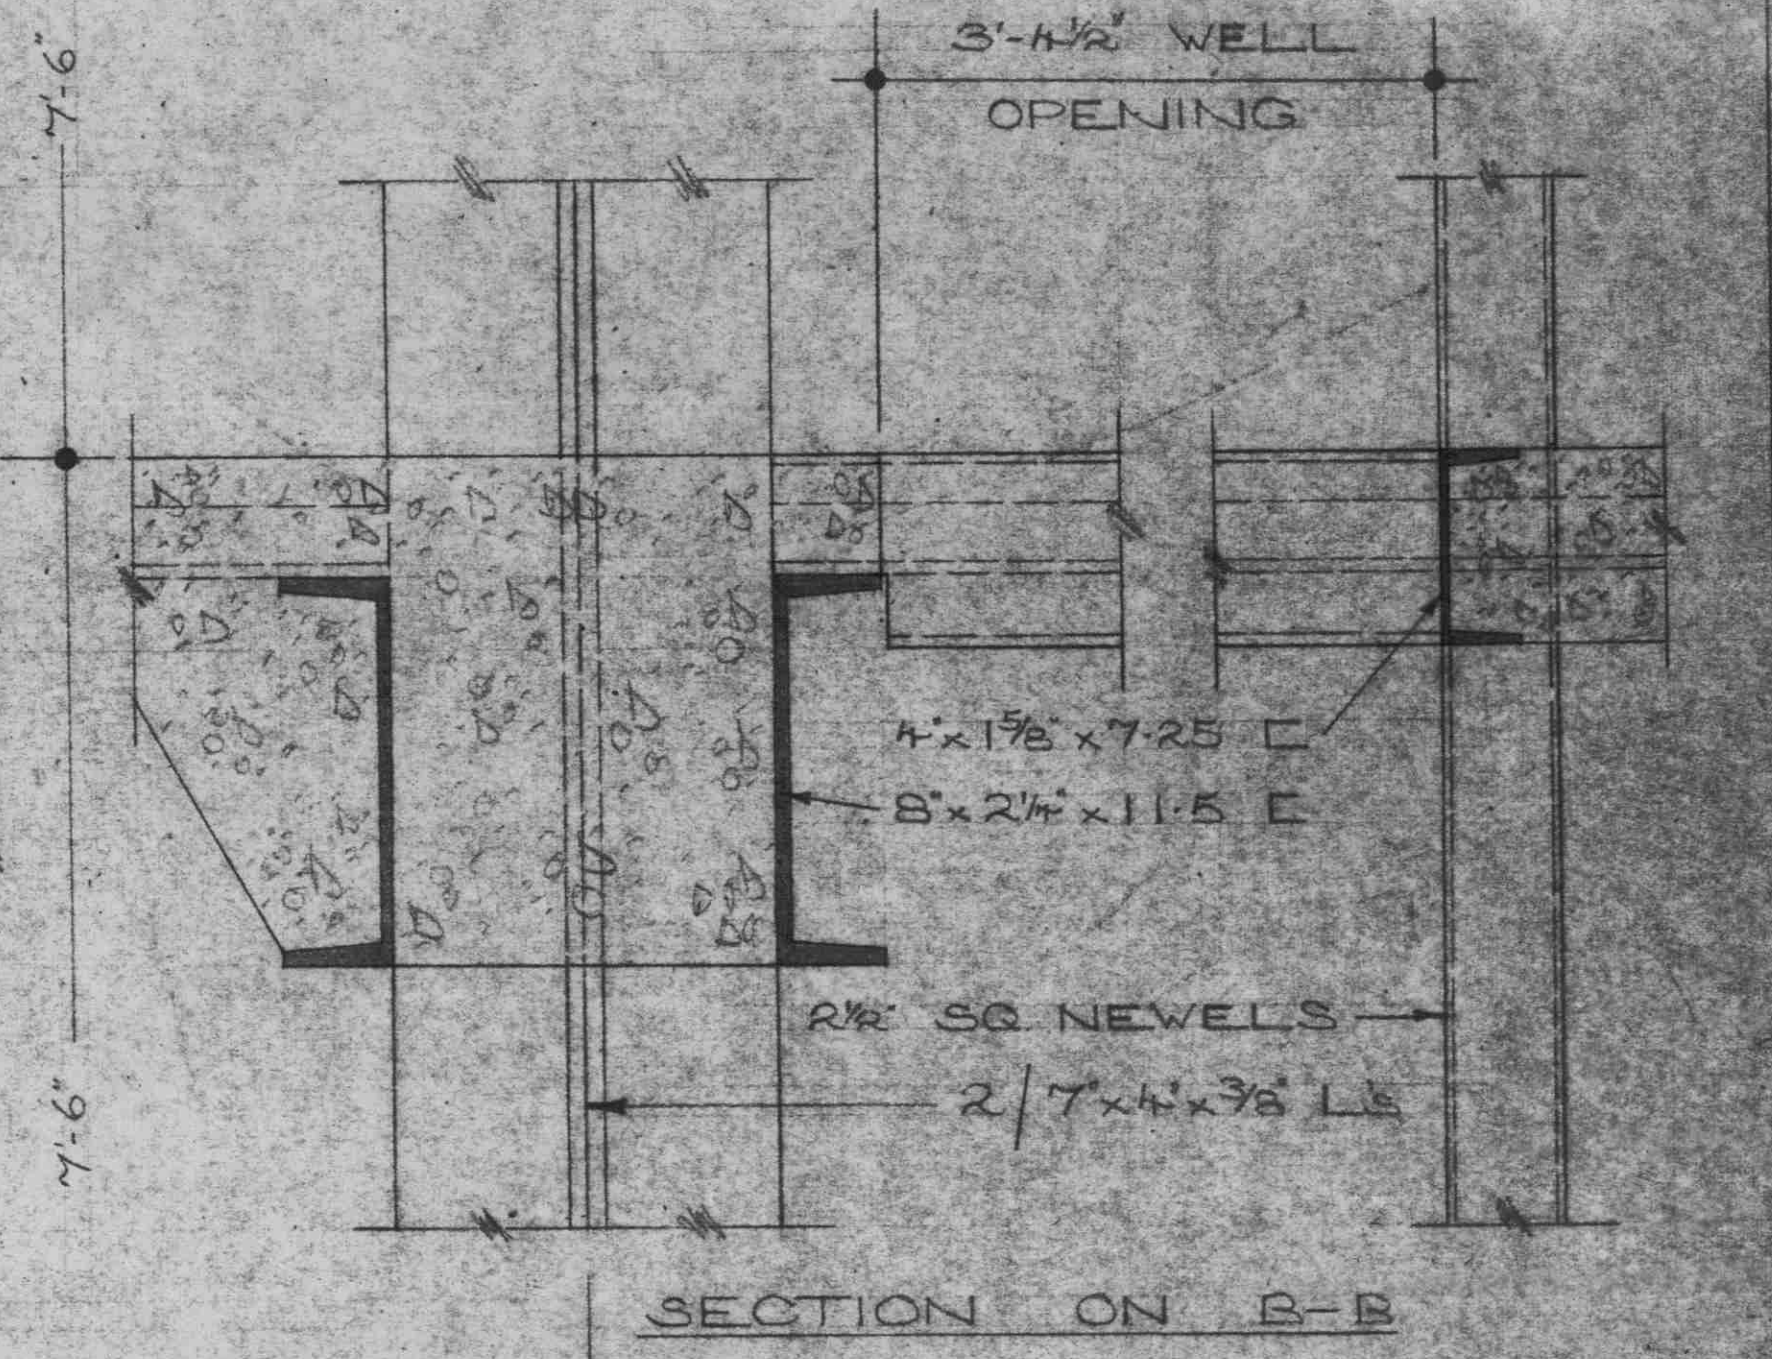
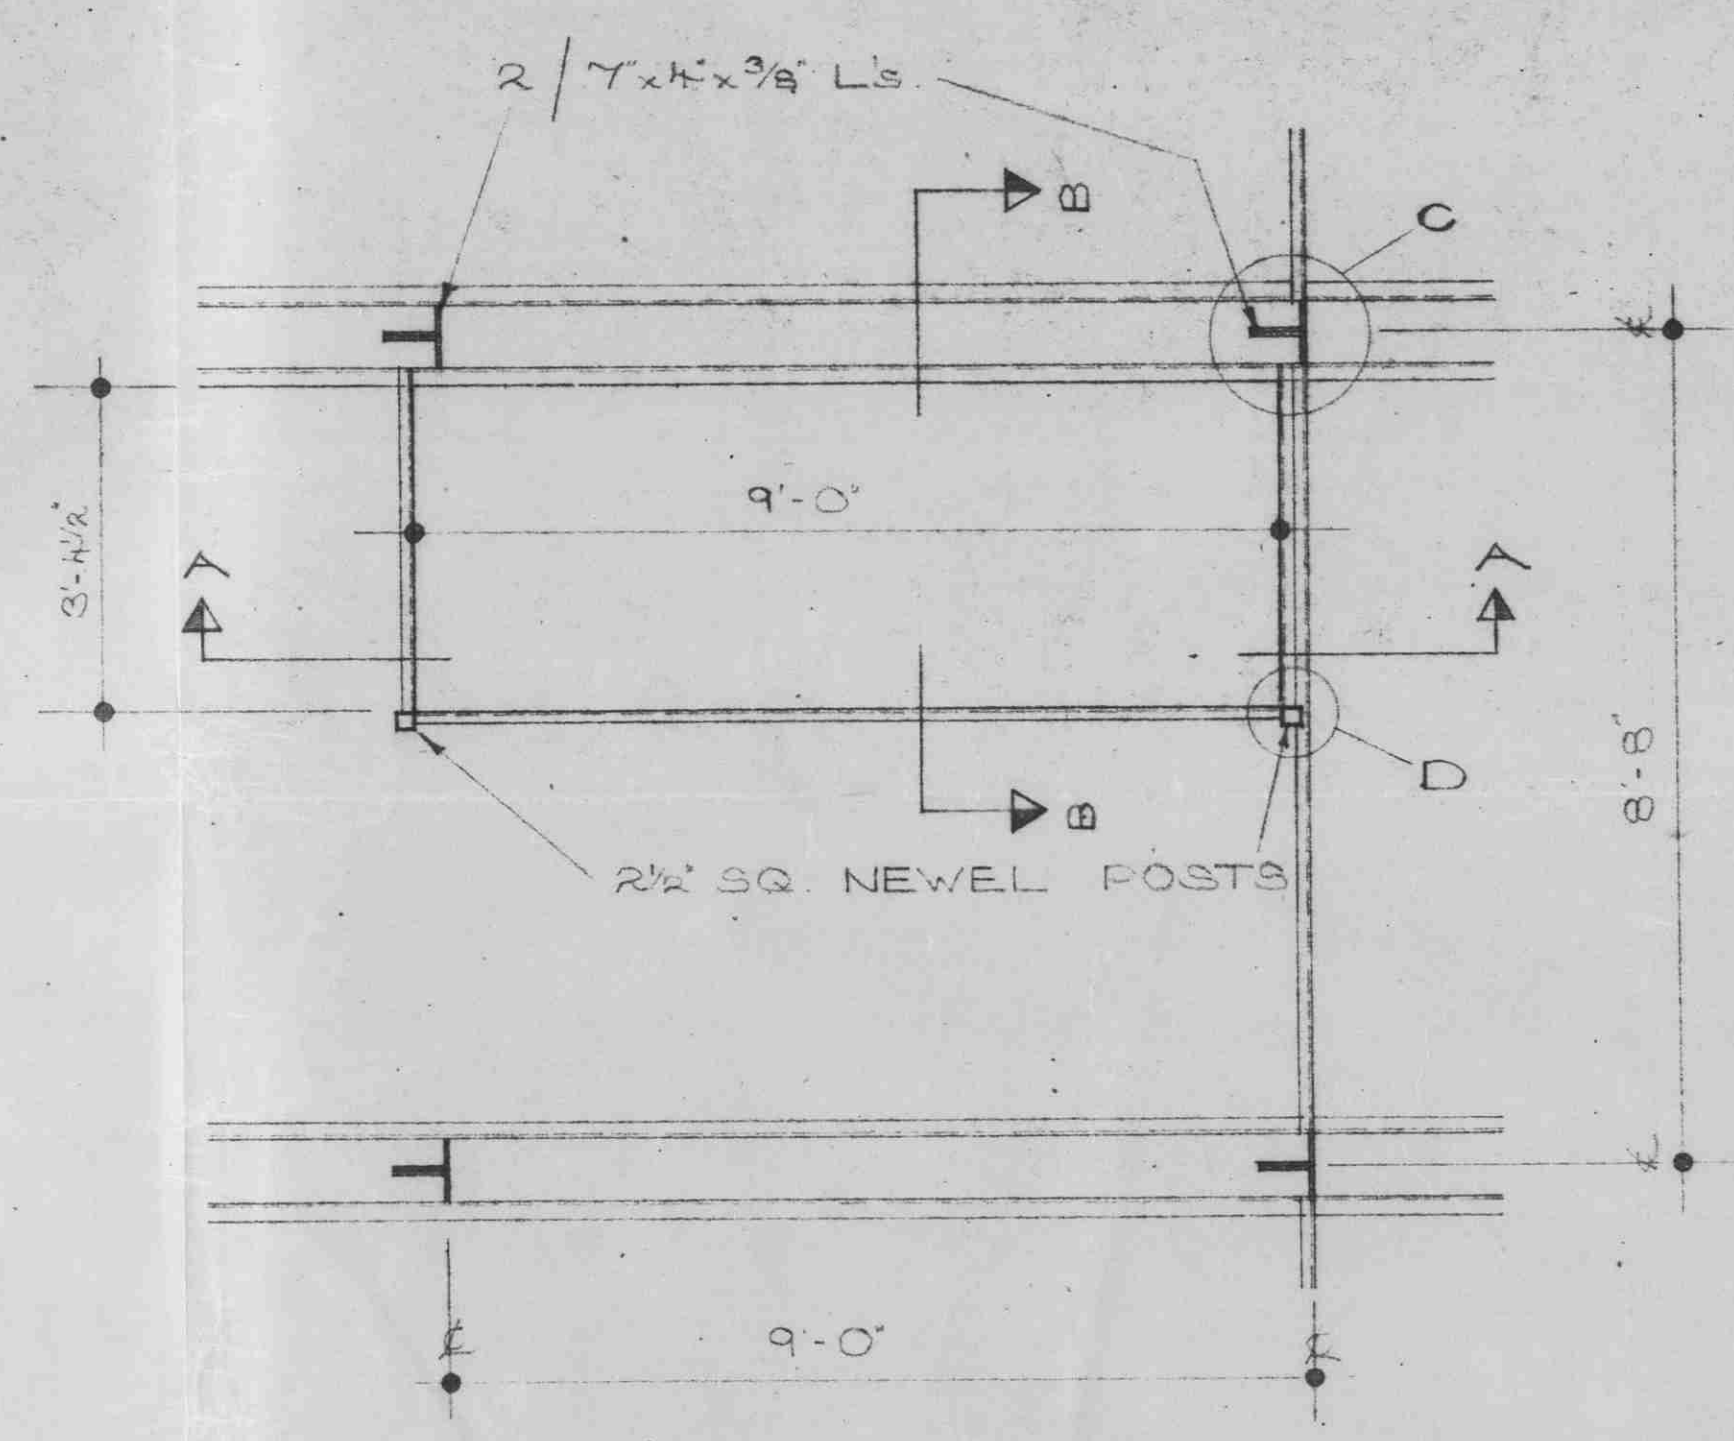
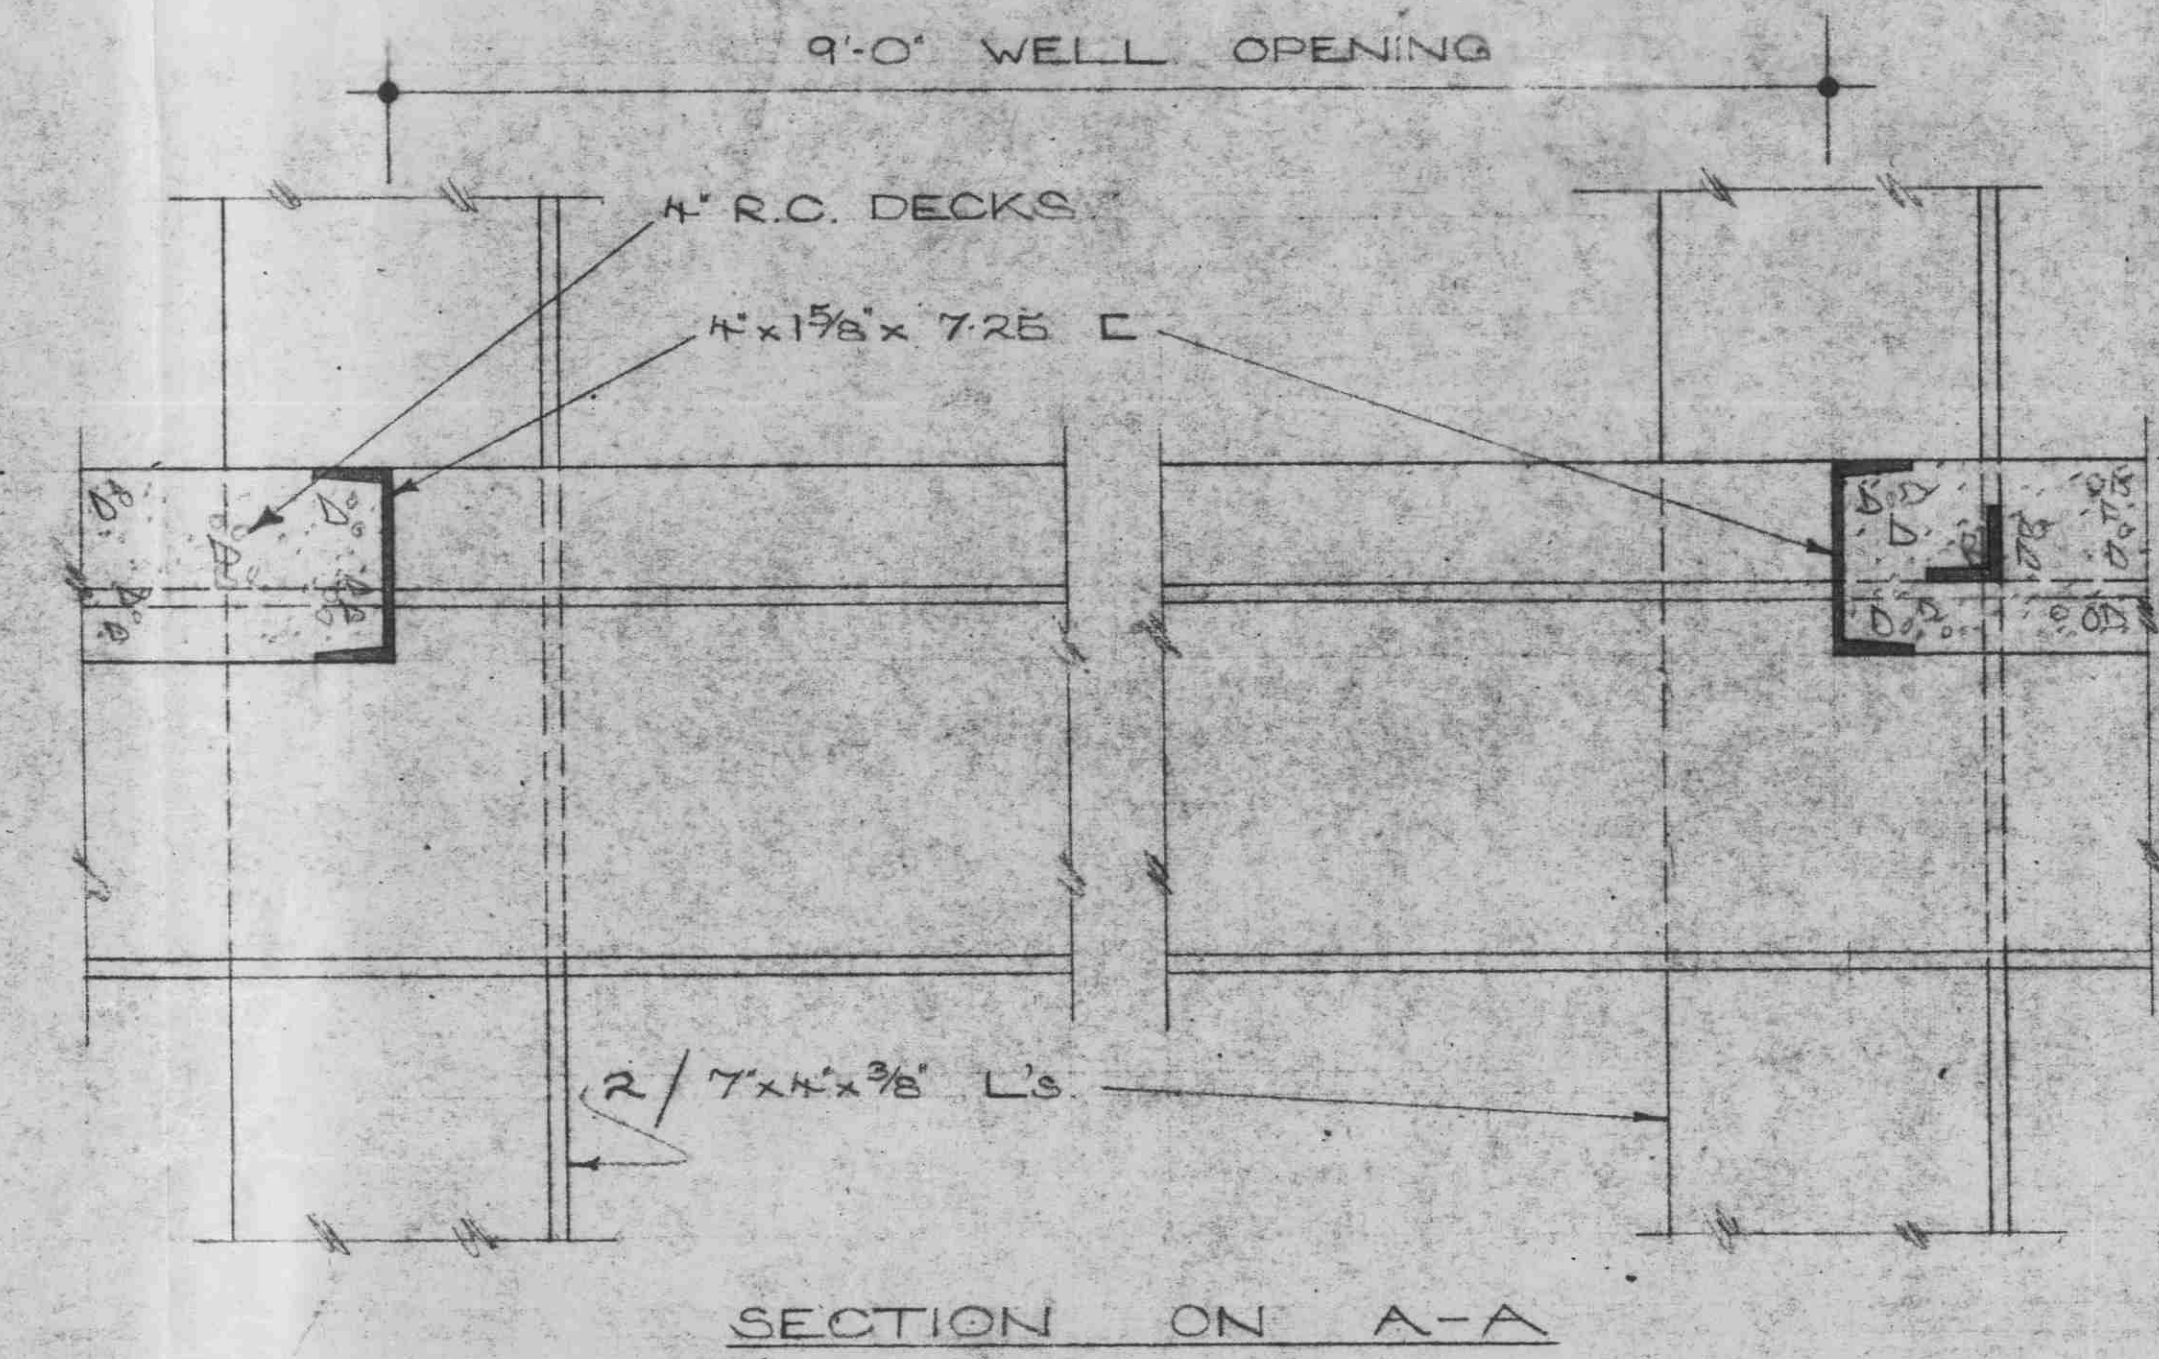
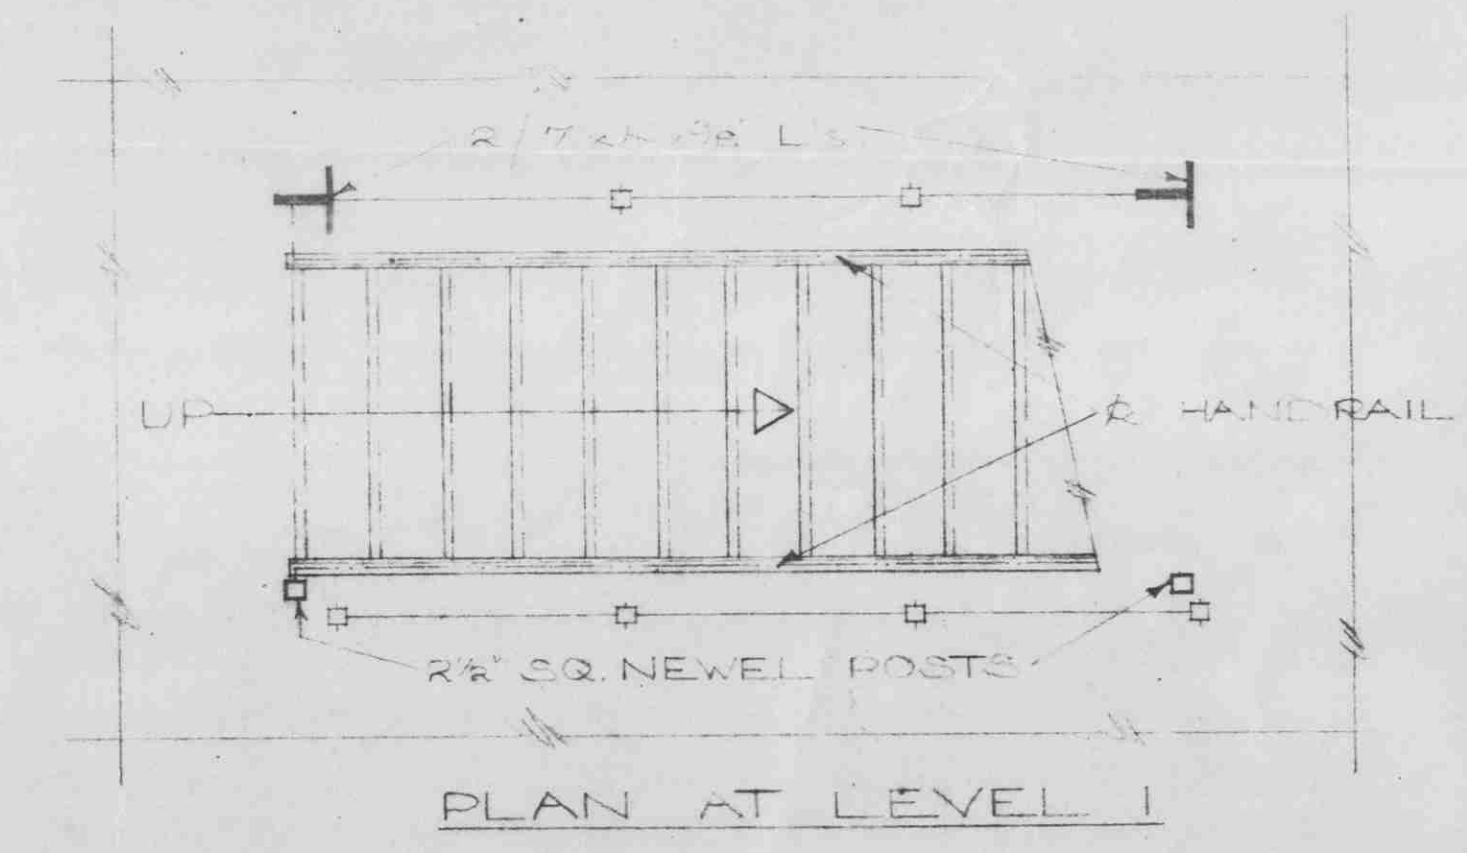
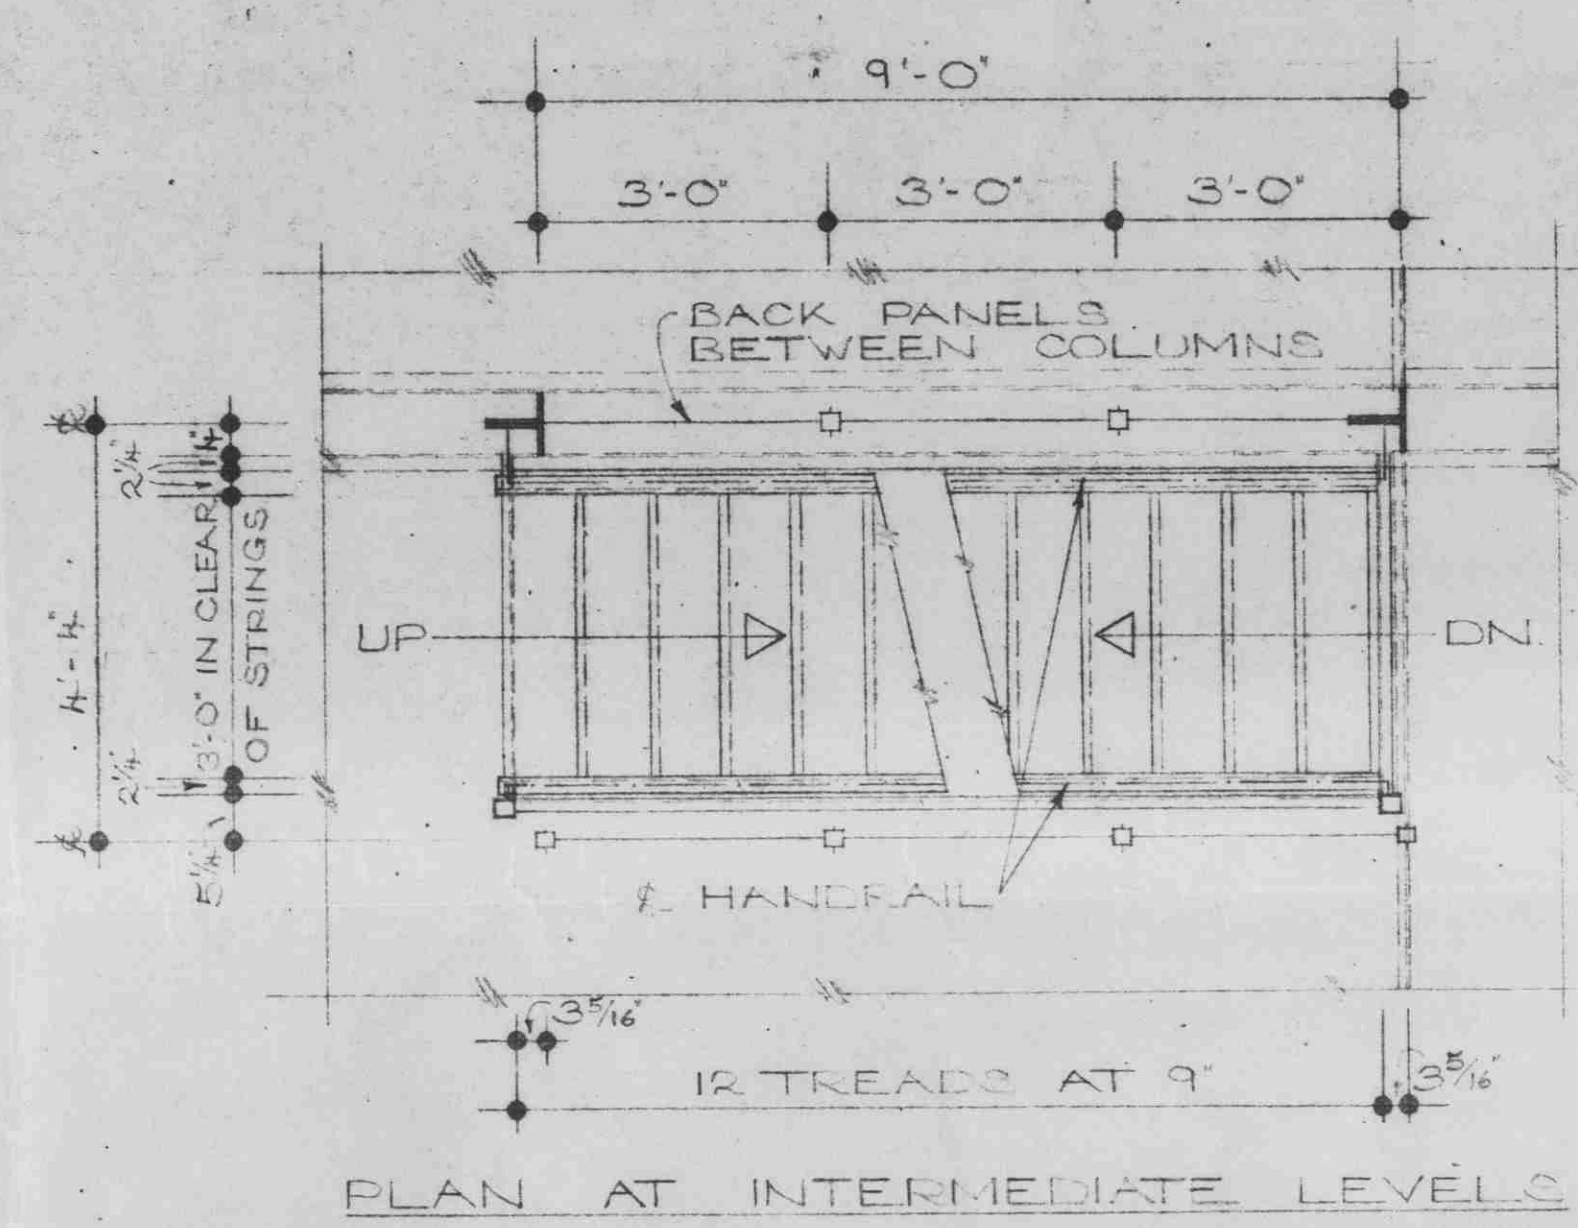
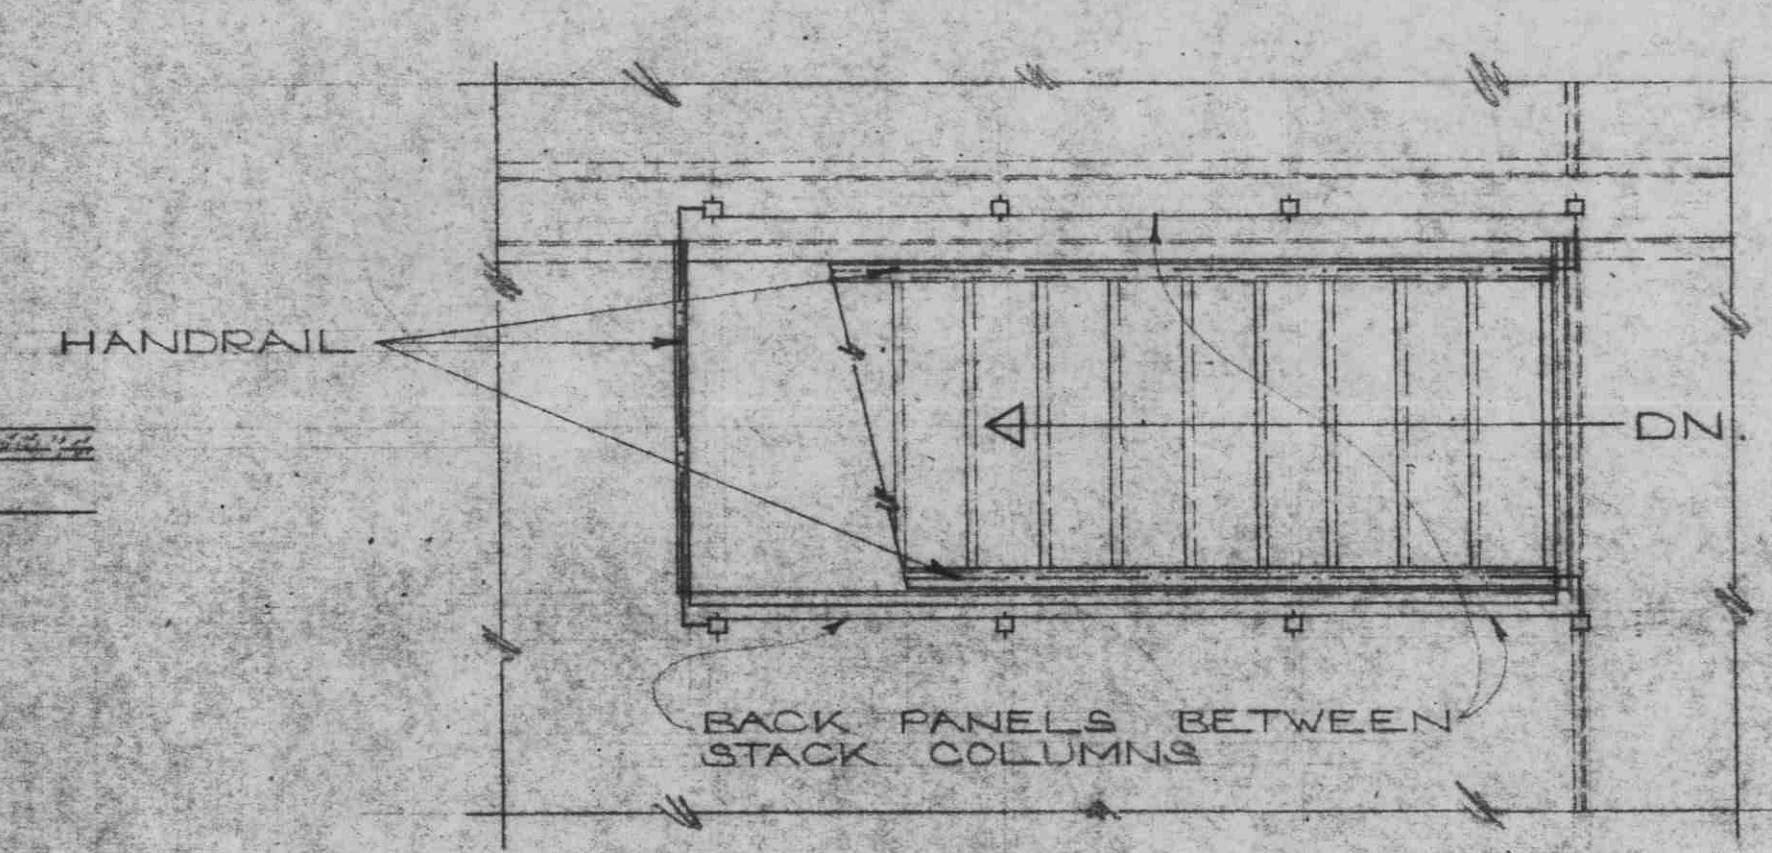


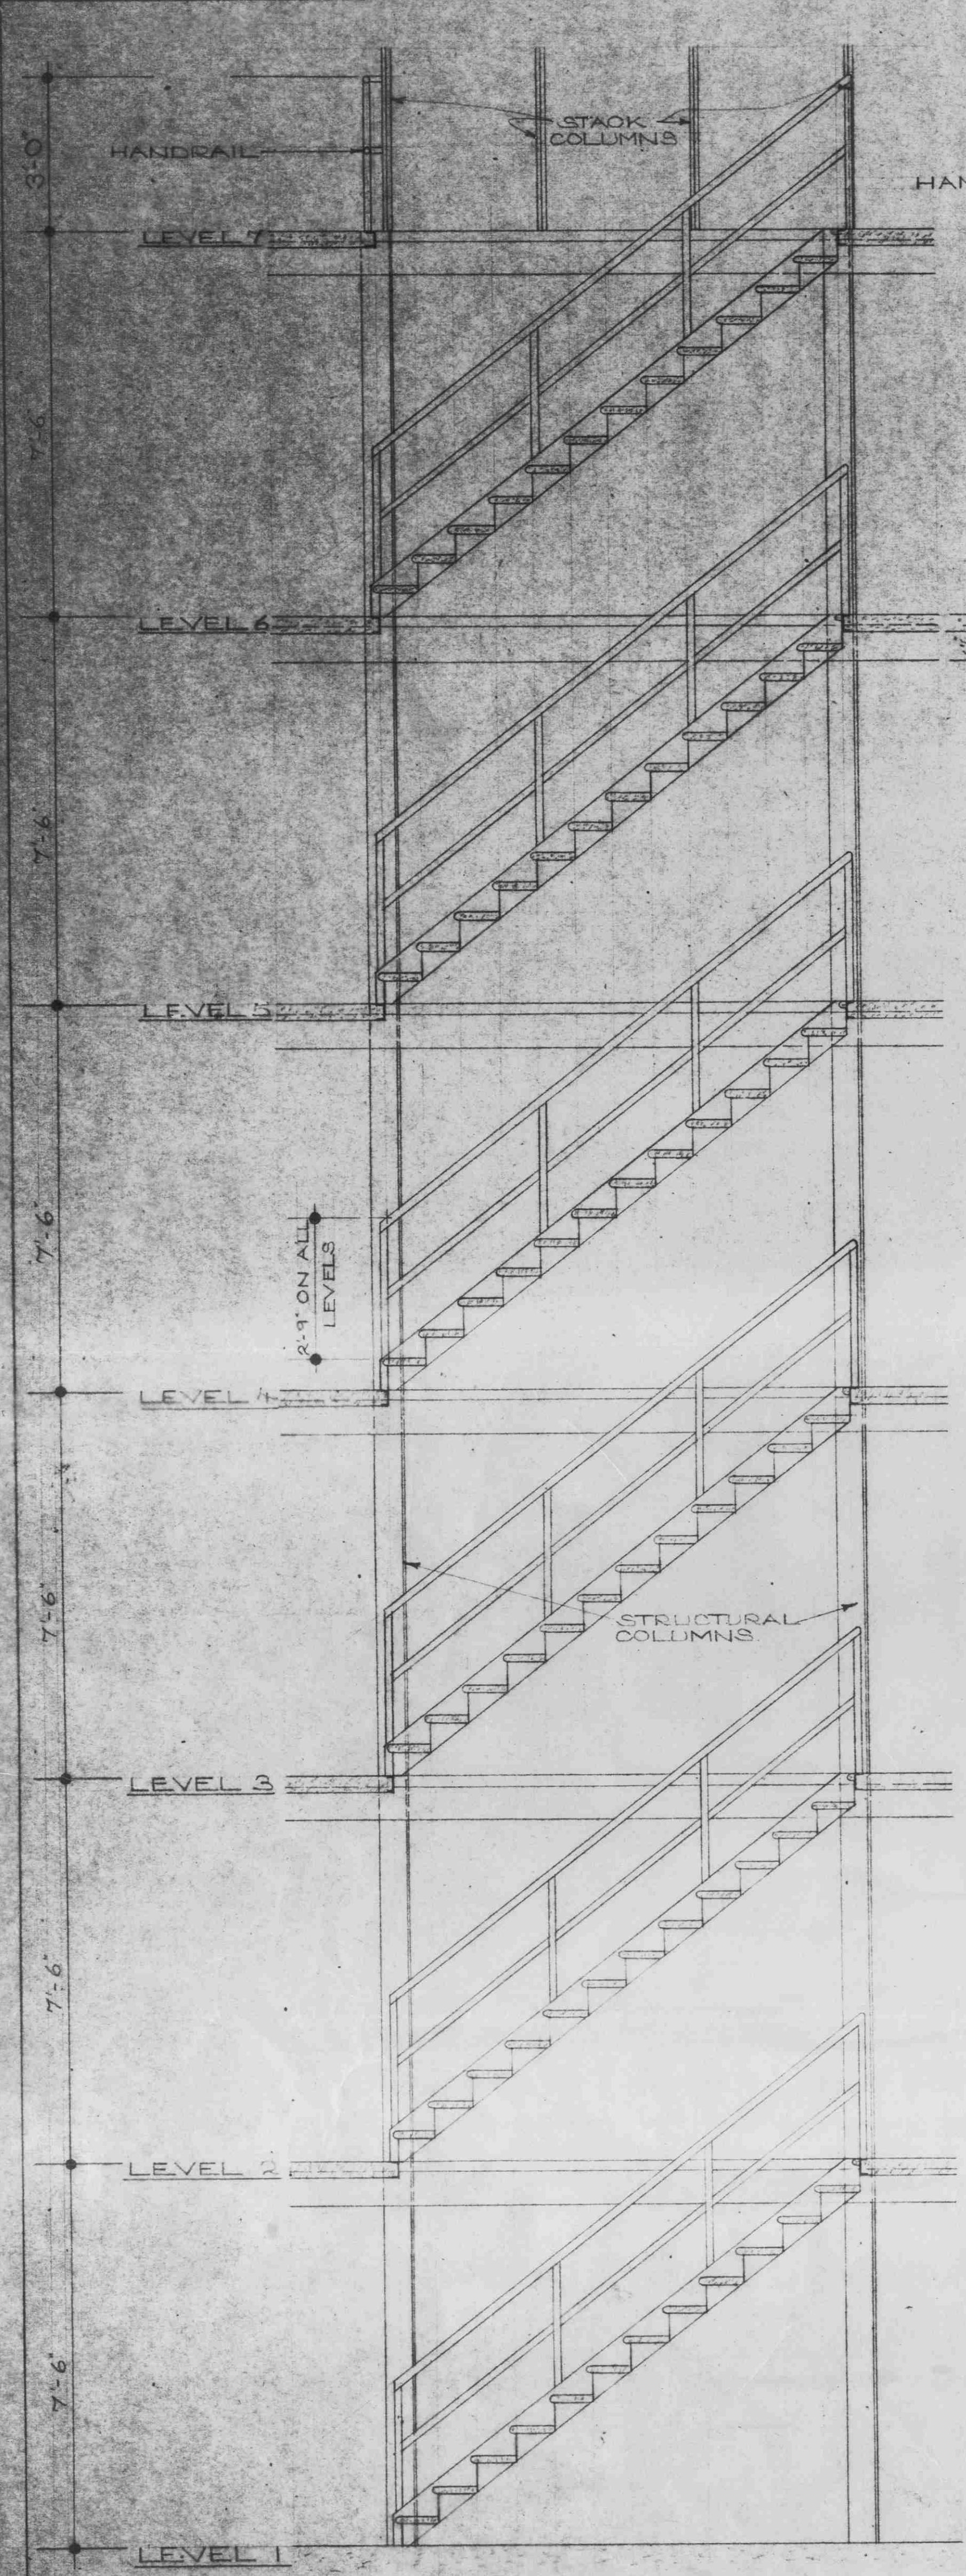

SPECIFICATION — STRINGERS OUT OF 8" x 2 1/2" CHANNELS WITH PRESSED STEEL TREADS & RISERS WITH INTEGRALLY FORMED NOSING OF NOT LESS THAN 1/4" G. STEEL (PERFORATED). SIZE BETWEEN STRINGERS TO BE 3'-0". TREADS TO BE FILLED WITH CEMENT & COVERED WITH 3/16" ASPHALT TILE TO MATCH REMAINDER OF JOB. HANDRAIL OUT OF 1 1/2" INSIDE DIA. PIPE. STACK COLUMNS & BACK PANELS TO ALL FLOORS BY LUXFER LTD. ALLOW FOR 3/16" ASPHALT TILE ON ALL FLOORS.

RE UNIVERSITY OF BRITISH COLUMBIA	
DETAILS OF STAIRS	DRAWING NO. SE 2530
SCALE — 1/2" TO 1'-0"	DATE 21-1-57
1 1/2" FULL SIZE	REVISIONS
LUXFER LTD. B.C.	CONTRACT NO. 24-74-6