


FLUORESCENT LIGHTING SCHEDULE

FIXTURE	SECTION	NO. OF LAMPS	CIRCUIT
Ⓐ	Ⓐ	7	B6
Ⓐ	Ⓐ	5	B6
Ⓐ	Ⓐ	5	B6
Ⓐ	Ⓐ	5	B6
Ⓐ	Ⓐ	16	B14
Ⓐ	Ⓐ	7	B14
Ⓐ	Ⓐ	4 - 40 W.	B16
Ⓐ	Ⓐ	1 - 20 W.	B16
Ⓐ	Ⓐ	2	B16

- SYMBOL SCHEDULE**
- - EXISTING OUTLETS TO BE COVERED WITH BLANK COVERS.
 - ⊗ - CEILING OUTLET.
 - ⊕ - BRACKET OUTLET 10' ABOVE FLOOR.
 - ⊙ - DUPLEX OUTLET RECEPTACLE IN CEILING.
 - ⊖ - DUPLEX OUTLET RECEPTACLE IN WALL.
 - ⚡ - SWITCH.
- NOTE - RECEPTACLES AND SWITCHES TO BE INSTALLED SIMILAR TO THOSE IN THE REST OF THE BUILDING.

- CIRCUIT HOME RUNS**
- ① - 1/2" - 2 #14 - B15
 - ② - 1/2" - 5 #14 SYNTHETIC-INSULATED - B1, 2, 5.
 - ③ - 1/2" - 5 #14 SYNTHETIC-INSULATED - B2, 3, 14.
 - ④ - 1/2" - 3 #14 SYNTHETIC-INSULATED - B5, 7, 9, 11, 12, 13.
 - ⑤ - 1/2" - 3 #14 - B9, 10.
 - ⑥ - 1/2" - 2 #14 - B4.

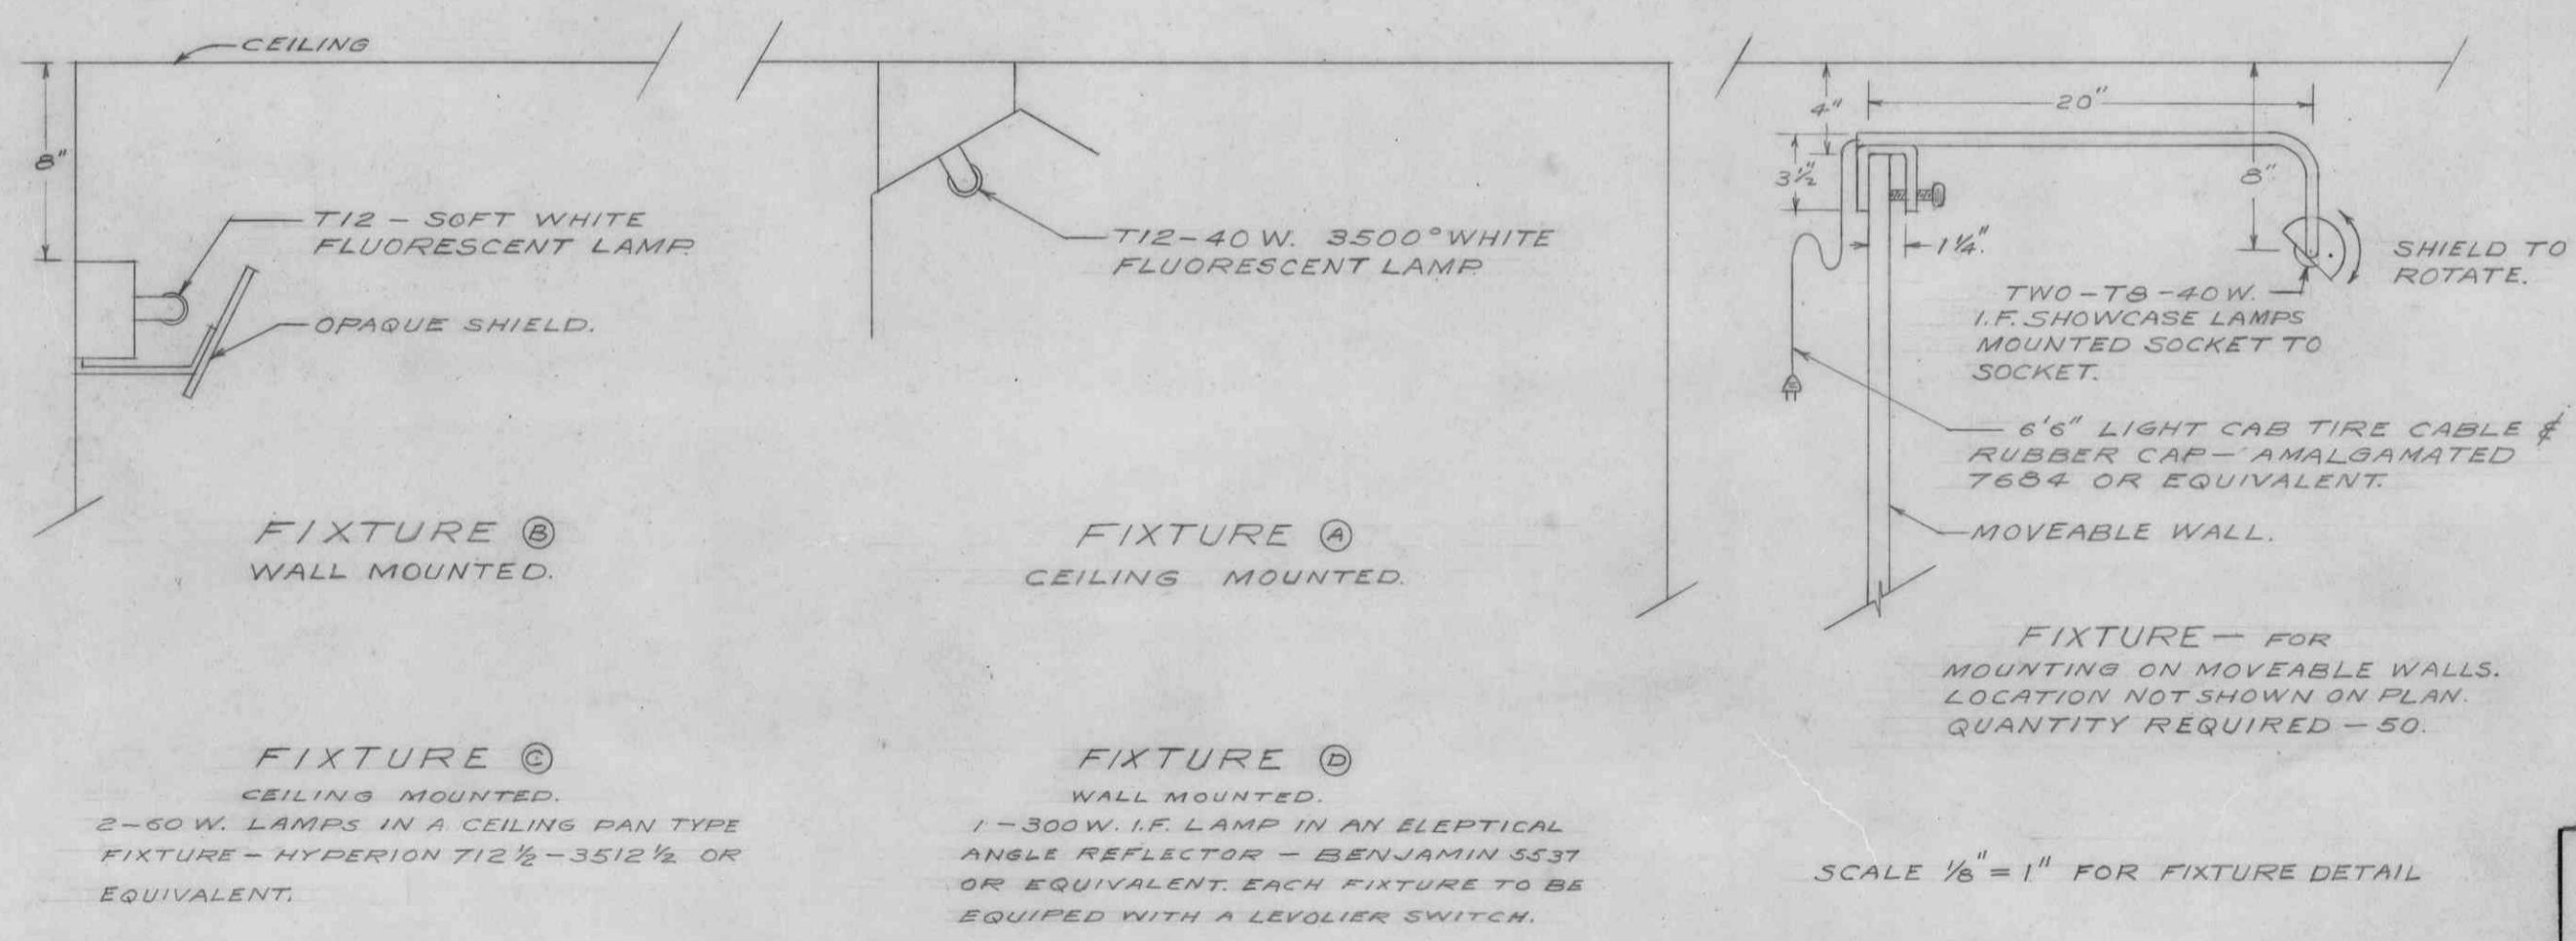

PROPOSED ART GALLERY NO.1 STACK LEVEL UBC LIBRARY		
REVISION DATE	SHARP & THOMPSON BERWICK, PRATT ARCHITECTS VANCOUVER - B.C.	DATE MAY 8, 1948
A. EDWARD SIMPSON CONSULTING ELECTRICAL ENGINEER VANCOUVER, B.C.		SCALE 1/8" = 1" DRAWING NO. U2-5-9

REVISION OF STACK LEVEL #1
LIBRARY BUILDING - U.B.C. 1/8" = 1'-0"